


CleanAir™ Industrial Filtration Unit

GH-2442-40X

September 2025

Assembly Instructions

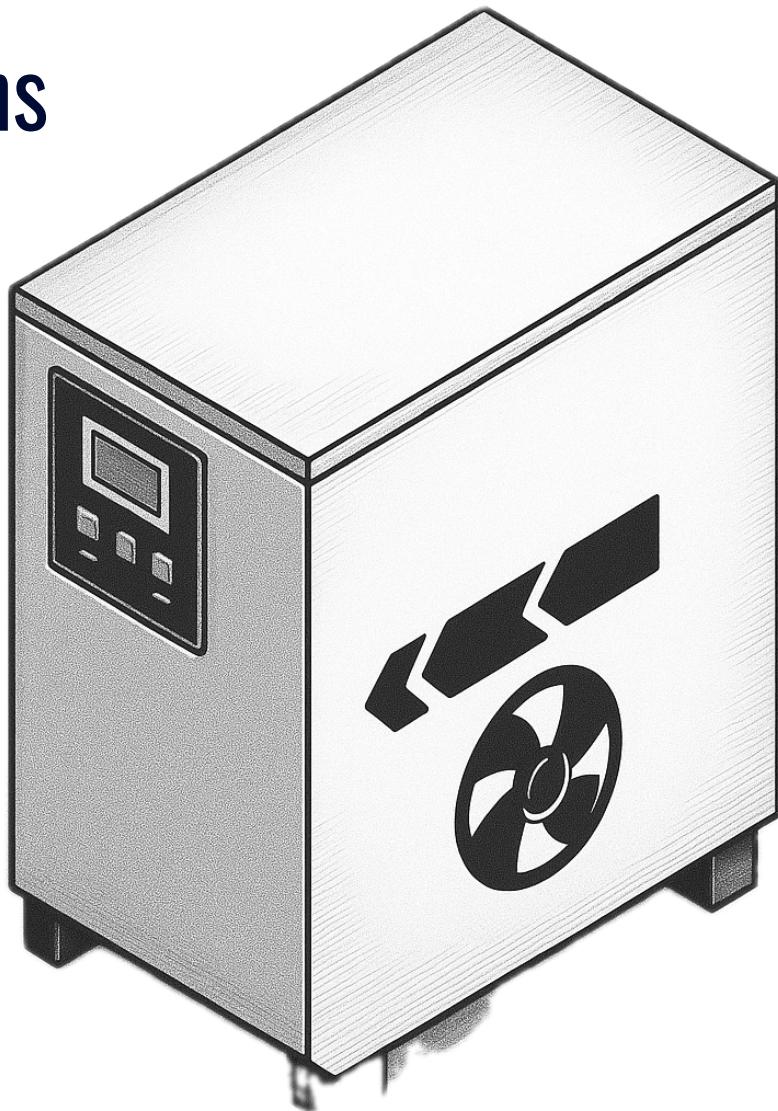

G GREAT
HARDWARE

Important Notice: This document contains assembly instructions only. Please refer to the User Manual included in the package for detailed safety guidelines, warranty terms, operation instructions, and maintenance procedures.

Key Features

- HEPA and ULPA filtration modules
- Vibration-resistant fans with silent operation
- Smart scheduling and filter alerts
- Compact industrial rack form factors


Safety Warnings

⚠ Read before assembly


- Always disconnect power before installation.
- Wear protective gloves and eyewear.
- Do not expose filters to moisture before use.
- Ensure unit is placed on stable, level flooring.
- Lift with two people – unit exceeds 40 kg.

Package Contents


1. Main housing unit (rack form factor)
2. HEPA/ULPA filter modules (x2)
3. Fan assembly with vibration mounts (x1)
4. Control panel with smart scheduler (x1)
5. Mounting brackets (x4)
6. Screws and fasteners set (x1 bag)
7. Power cable (x1)
8. User manual & warranty card

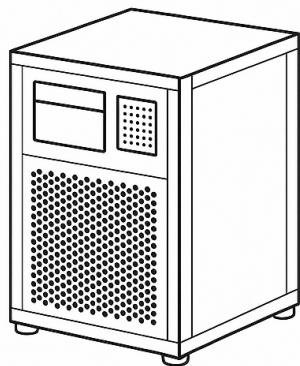


Main housing unit

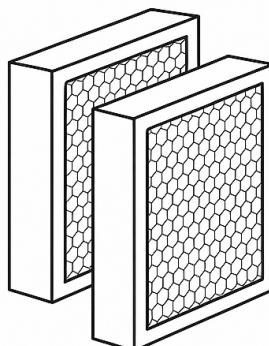


HEPA/ULPA filter modules (x2)




Fan assembly with vibration mounts (x1)



Mounting brackets (x4)



Screws and fasteners set (x1 bag)



Power cable (x1)




User manual & warranty card

Tools Required

- Phillips screwdriver
- Adjustable wrench
- Torque driver (recommended)
- Protective gloves



Phillips
screwdriver

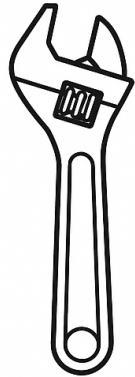

Adjustable
wrench




Torque driver
(recommended)



Protective
gloves


Assembly Instructions

Step 1 – Prepare the Area

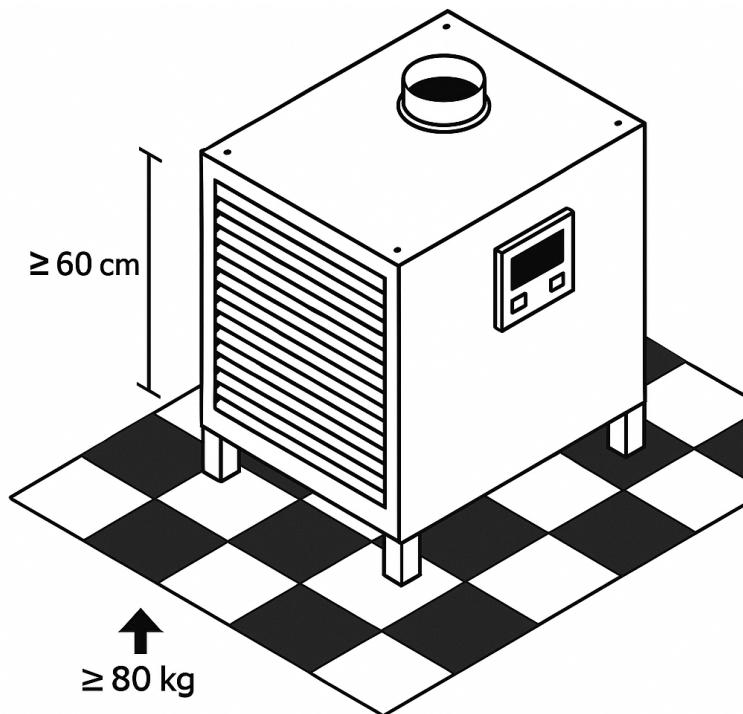


- Place unit on a flat surface with clearance of at least 60 cm on all sides.
- Verify floor can support at least 80 kg.


Step 2 – Install Mounting Brackets

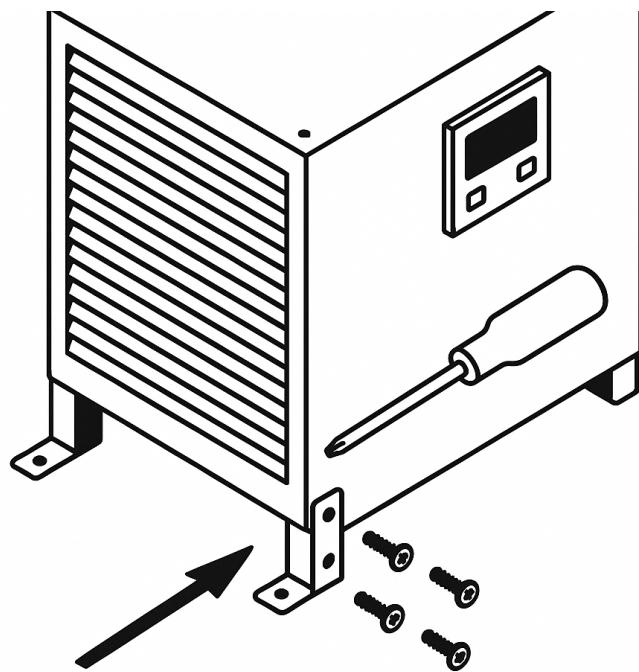


Step 3 – Insert Filter Modules

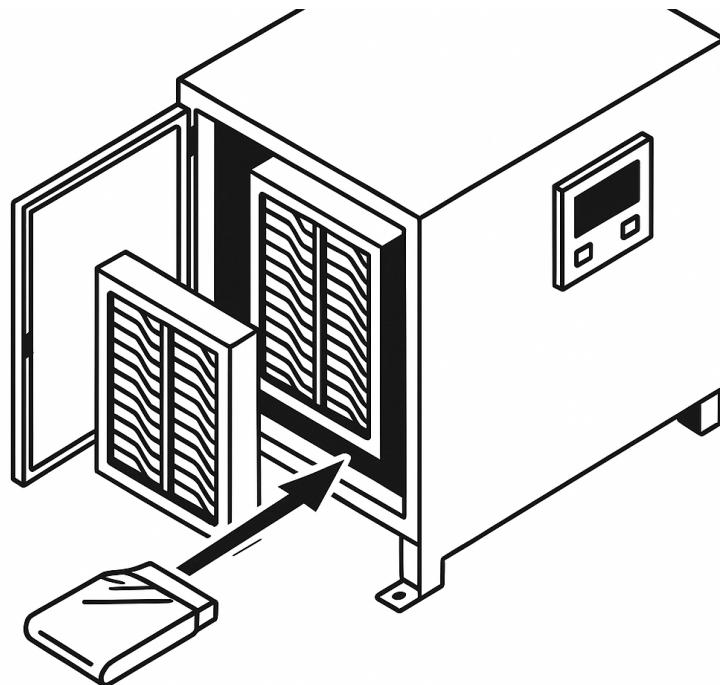


Step 4 – Install Fan Assembly

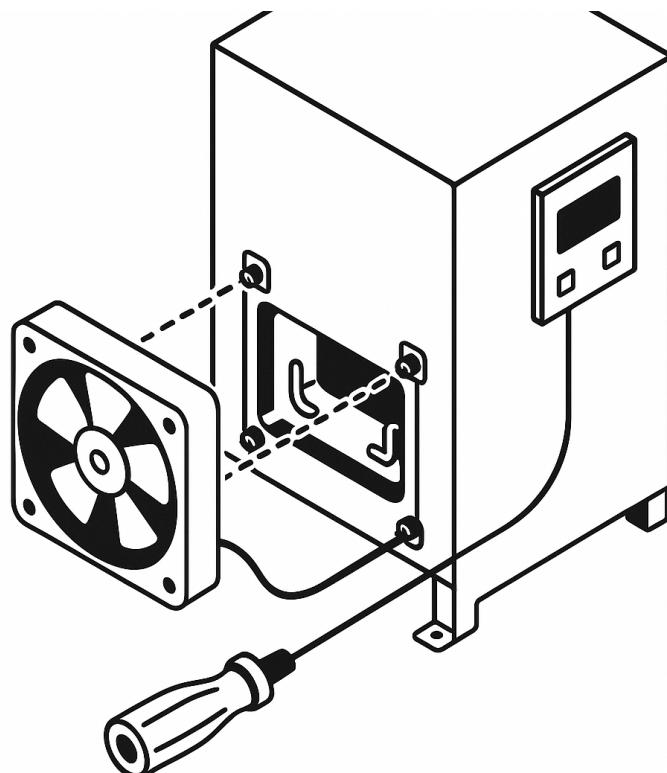


Step 5 – Attach Control Panel

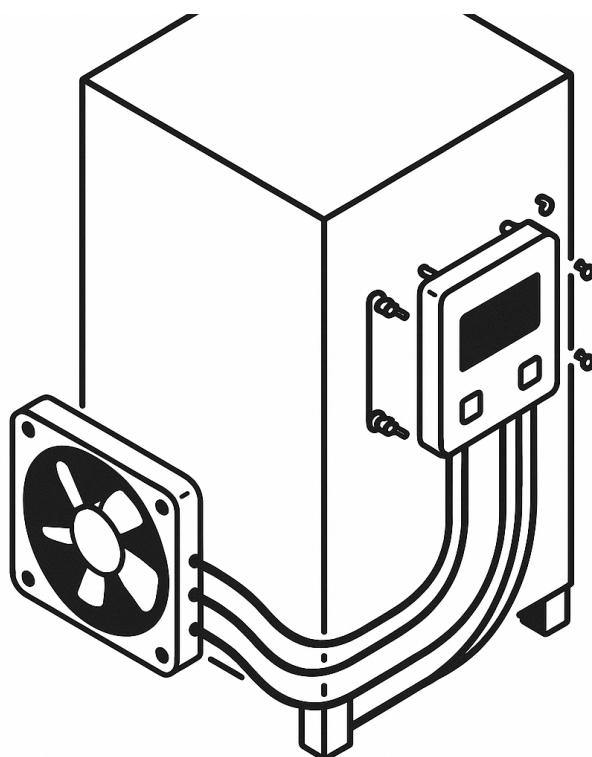

Step 6 – Connect Power

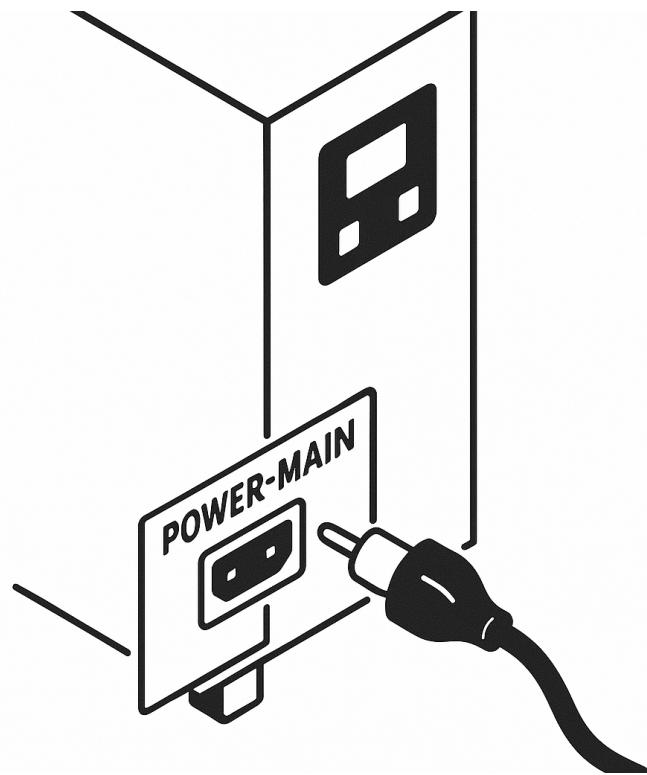

Step 7 – Final Checks

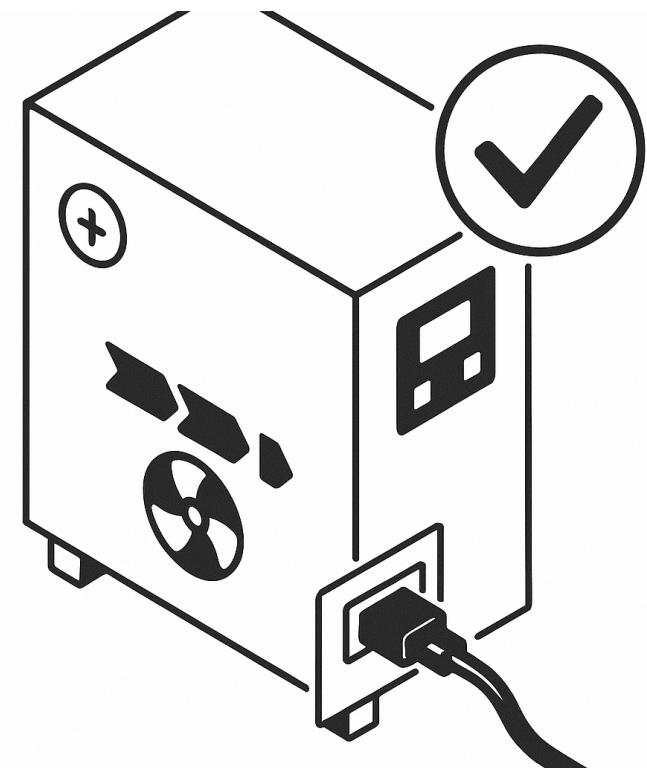



1. Verify all screws are tight and no components are loose.
2. Check airflow path is clear of debris.
3. Confirm all wiring harnesses are secured.

Initial Power-Up

1. Switch power ON.
2. Control panel should display: **System Ready**.
3. Run “Test Airflow” from the scheduler menu.
4. Confirm airflow meets specifications before use




Maintenance Notes

- Replace filters every **6-12 months** or as indicated by alerts.
- Inspect fan vibration mounts annually.
- Schedule service checks through authorized technician.
- For more detailed information check the Maintenance section in the User Manual.



Thanks for Checking Out This PDF Export Example

This PDF was written in Confluence and exported using Scroll PDF Exporter.

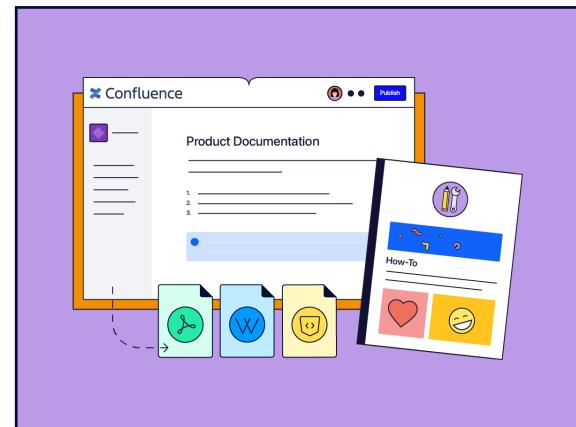

Create Beautiful, Branded PDFs from Confluence

Turn your Confluence content into professionally designed PDFs that match your brand and look great every time with Scroll PDF Exporter.

[Try it free for 30 days →](#)



Want To Do Even More With Your Exports?

Scroll Exporter Extensions is a free Marketplace app that gives you extra control over how content is used and formatted during export – directly in your Confluence page content.

[Install it now →](#)



By the Way...

If PDFs aren't the only thing you export, we've got you covered.

Check out [Scroll Word Exporter](#) and [Scroll HTML Exporter](#) for quick, clean exports in other offline formats.

And if you want to publish Confluence content online, [Scroll Sites](#) helps you create beautiful help centers, knowledge bases, blogs, and more.

Liked This Template?

There are even more templates to explore – head to the PDF Template Library.

[Browse Templates →](#)

✓ Reports ✓ Letterheads ✓ Onboarding Plans ✓ User Manuals ✓ Product Fact Sheets

